



<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 1
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

Concorde Glass Ltd.,  
Linx House,  
104 Waterloo Rd,  
Mablethorpe,  
LN12 1LE,  
UK.

Glassloc Side Mount Channel  
Fixing Data Sheets Concrete Steel Timber

Analysis By	Checked By
A.N & R.F. & CC	C.K

0	15/04/2024	T.S.	Issued
<b>Revision</b>	<b>Date</b>	<b>Issued By</b>	<b>Comment</b>



<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 2
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

**Contents**

**Introduction/Actions/Assumptions/Result Summary: ..... 3**

Introduction:..... 3

Actions: ..... 3

Assumptions: ..... 3

Result Summary:..... 3

**Glass Strength..... 4**

    Balustrade Loading: ..... 4

    Wind Loading:..... 4

**Side Mount Shoe – Side Fix Connections: ..... 5**

    Sketch of System: ..... 5

    Connection to Concrete Design - Side Fixed: ..... 7

    Connection To Mild Steel Baseplate - Side Fixed: ..... 8

    Connection To Wood - Side Fixed: ..... 9

**Shoe Analysis:.....10**

**Appendix A – Timco Timber Screws Specification Sheet.....13**

**Appendix B – Fischer Reports .....16**

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 3
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

## Introduction/Actions/Assumptions/Result Summary:

### Introduction:

TSA was instructed by Concorde Glass Ltd to provide the below Calculations:

- 1- Provide fixing details for the side-mounted U Channel system into concrete, steel, and timber.

### Actions:

Balustrade load = 0.74kN

(Table NA.6 IS1991-1-1:2002)

Point load = 0.5kN

(Table NA.5 IS1991-1-1:2002)

Typical High Wind load = 2.5kN/m<sup>2</sup>

### Assumptions:

Concrete Grade = C30/37

Bolts are grade 8.8 Mild Steel.

Timber Grade = C16 (minimum)

Aluminium Shoe grade 6063-T6 – Minimum strength is 195Mpa.

### Result Summary:

#### A. Side Fix Mount U – Channel:

- 1- **Connection to Concrete:** Use 1No. Ultracut FBS II 10×65 Zinc Plated Steel Fischer Countersunk Concrete screws @200mm C/C with Minimum Embedment depth is 43mm and Minimum edge distance is 70mm.
- 2- **Connection to Steel:** Use M10 Grade 8.8 Countersunk bolts @200mm C/C.
- 3- **Connection to Timber:** Use M10 Grade 8.8 Countersunk bolts @200mm C/C.
- 4- **Shoe:** 136×66mm Aluminium Shoe.

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 4
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

## Glass Strength

### Balustrade Loading:

< 5mins duration =>  $k_{mod} = 0.77$

$$f_{gd} = (k_{mod})(k_{sp})(f_{gk}) / \gamma_{ma} + k_v(f_{bk} - f_{gk}) / \gamma_{mv}$$

$$f_{gd} = (0.77)(1.0)(45) / 1.6 + 1.0(120 - 45) / 1.2$$

$$f_{gd} = \underline{84.2N/mm^2}$$

### Wind Loading:

10min duration, Multiple Gust Storm =>  $k_{mod} = 0.74$

$$f_{gd} = (k_{mod})(k_{sp})(f_{gk}) / \gamma_{ma} + k_v(f_{bk} - f_{gk}) / \gamma_{mv}$$


$$f_{gd} = (0.74)(1.0)(45) / 1.6 + 1.0(120 - 45) / 1.2$$

$$f_{gd} = \underline{83.3N/mm^2}$$

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.:</b> 5
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

**Side Mount Shoe – Side Fix Connections:**


Sketch of System:

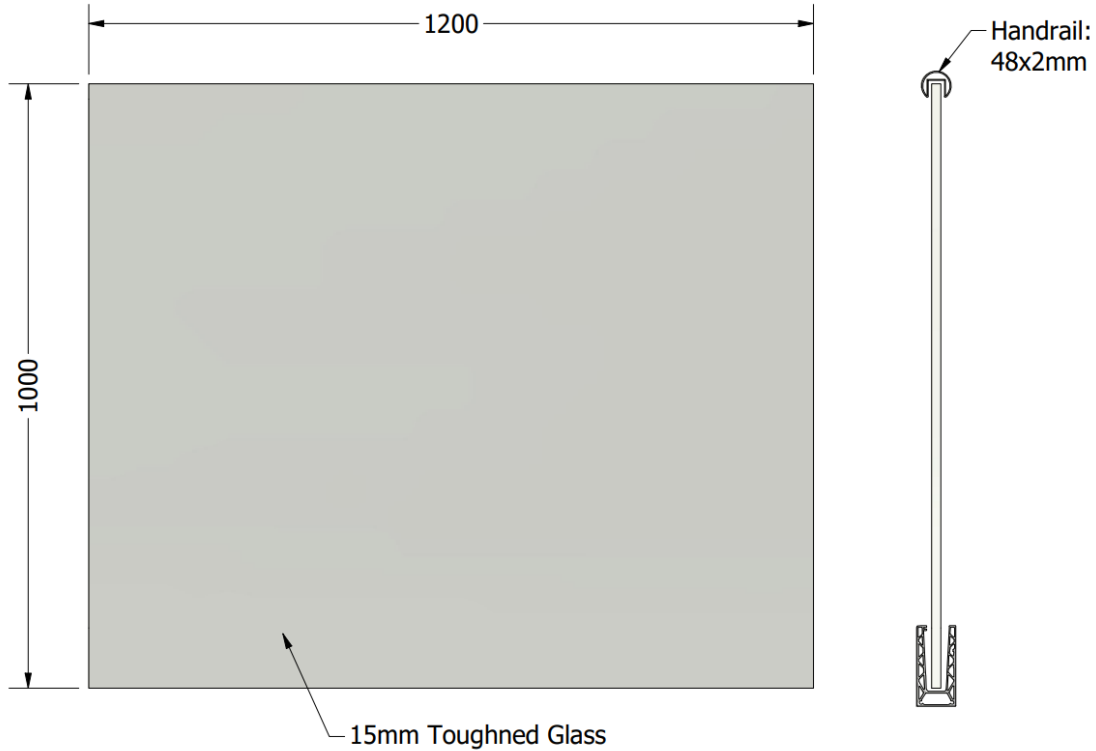

**Note:**

- 1- toughened glass is not permitted to bear horizontal balustrade loading on its own.  
As a result, a handrail must be designed specifically to support the horizontal balustrade load.

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 6
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

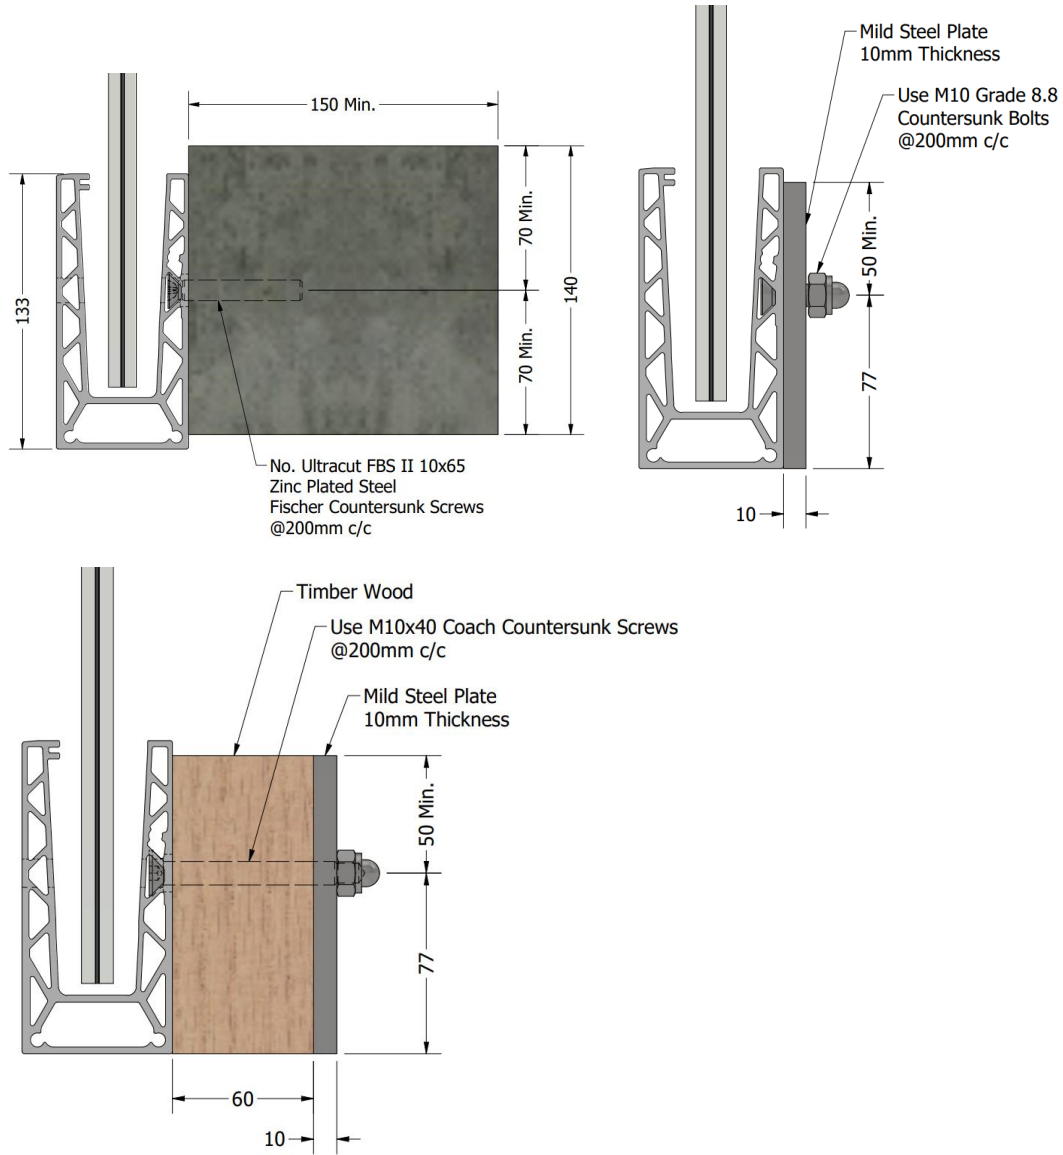

2- The above sketches are for illustration purposes only.

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 7
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

Connection to Concrete Design - Side Fixed:



Moment due to Balustrade Load =  $0.74\text{kN/m} \times 1.5 \times 0.6\text{m} \times 0.6\text{m} = 0.4\text{kNm}$  (ULS)

Moment due to Wind Load =  $2.5\text{kN/m}^2 \times 1.5 \times 0.6\text{m} \times 0.6\text{m} \times 0.33\text{m} = 0.45\text{kNm}$  (ULS) – **Worst Case.**

Shear Load due to Balustrade load =  $0.74\text{kN/m} \times 1.5 \times 0.6\text{m} = 0.666\text{kN}$  (ULS)

Shear Load due to Wind load =  $2.5\text{kN/m}^2 \times 1.5 \times 0.6\text{m} \times 0.6\text{m} = 1.35\text{kN}$  (ULS) – **Worst Case.**

**Therefore, use 1No. Ultracut FBS II 10x65 Zinc Plated Steel Fischer Countersunk Concrete screws@200mm C/C with Minimum Embedment depth is 43mm and Minimum edge distance is 70mm as per the screenshot below.**

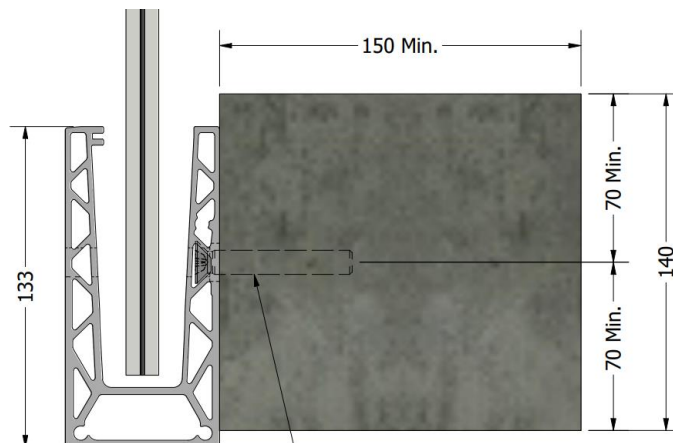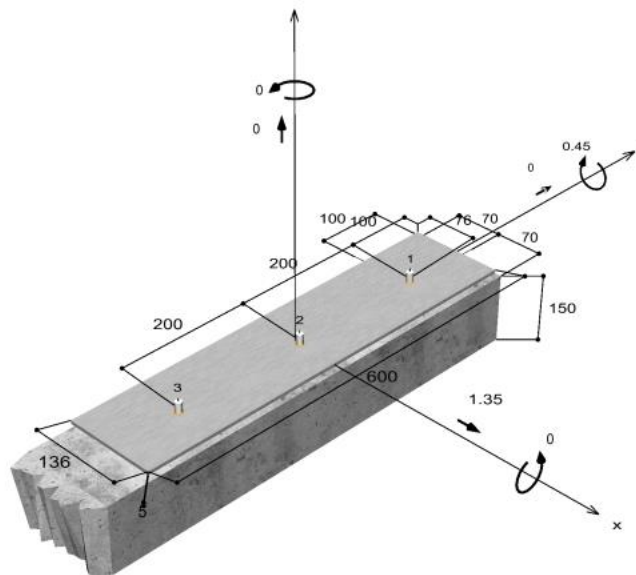

No. Ultracut FBS II 10x65  
Zinc Plated Steel  
Fischer Countersunk Screws  
@200mm c/c

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 8
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

Connection To Mild Steel Baseplate - Side Fixed:

**M10 Grade 8.8 Countersunk Bolt:**

$$f_{ub} = 800 \text{ MPa} \quad (\text{Grade 8.8 Mild Steel, Table 3.1 EN 1993-1-8:2005})$$

$$\alpha = 0.6 \quad (\text{Table 3.4 EN 1993-1-8:2005})$$

$$A = 58.00 \text{ mm}^2 \quad (\text{For M10 Bolts})$$

$$K_2 = 0.63 \quad (\text{Table 3.4 EN 1993-1-8:2005})$$

$$\lambda_{m2} = 1.25 \quad (\text{Table 5.1 EN 1993-1-4:2006})$$

**Tensile Resistance Check: (Table 3.4 EN 1993-1-8:2005)**

$F_{t,Ed}$ : is the design tensile force per bolt for the ultimate limit state.

$F_{t,Rd}$ : is the design tension resistance per bolt.

$$F_{t,Ed} = 2.7 \text{ kN}$$

$$F_{t,Rd} = \frac{K_2 F_{ub} A}{\lambda_{m2}} = \frac{0.63 \times 800 \times 58}{1.25} \times 10^{-3} = 23.38 \text{ kN} \rightarrow F_{t,Rd} = 23.38 \text{ kN} > 2.7 \text{ kN} \quad \text{Okay}$$

**Shear Resistance Check: (Table 3.4 EN 1993-1-8:2005)**

$F_{v,Ed}$ : is the design shear force per bolt for the ultimate limit state.

$F_{v,Rd}$ : is the design shear resistance per bolt.


$$F_{v,Ed} = 0.45 \text{ kN}$$

$$F_{v,Rd} = \frac{\alpha F_{ub} A}{\lambda_{m2}} = \frac{0.6 \times 800 \times 58}{1.25} \times 10^{-3} = 22.27 \text{ kN} \rightarrow F_{v,Rd} = 22.27 \text{ kN} > 0.45 \text{ kN} \quad \text{Okay}$$

**Combined Shear & Tensile Resistance Check: (Table 3.4 EN 1993-1-8:2005)**

$$\frac{F_{v,Ed}}{F_{v,Rd}} + \frac{F_{t,Ed}}{1.4 F_{t,Rd}} \leq 1 \rightarrow \frac{0.45}{22.27} + \frac{2.7}{1.4 \times 23.38} = 0.103 \leq 1 \quad \text{Okay}$$

**Therefore, Use M10 Grade 8.8 Countersunk Bolts @200mm C/C.**

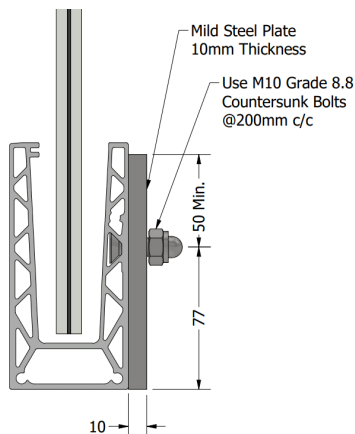



<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 9
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

Connection To Wood - Side Fixed:

**Tensile Resistance Check:**


Tensile Force per screw = 2.7kN

Tension Capacity of 10 × 40mm Coach Screws = 26.45kN as per specification sheet in appendix A.

Therefore, 26.45kN > 2.7kN **Okay**


**Minimum edge distance required is  $5d = 5 \times 10 = 50\text{mm}$ .**

**Therefore, use M10 countersunk bolts. @200mm C/C.**

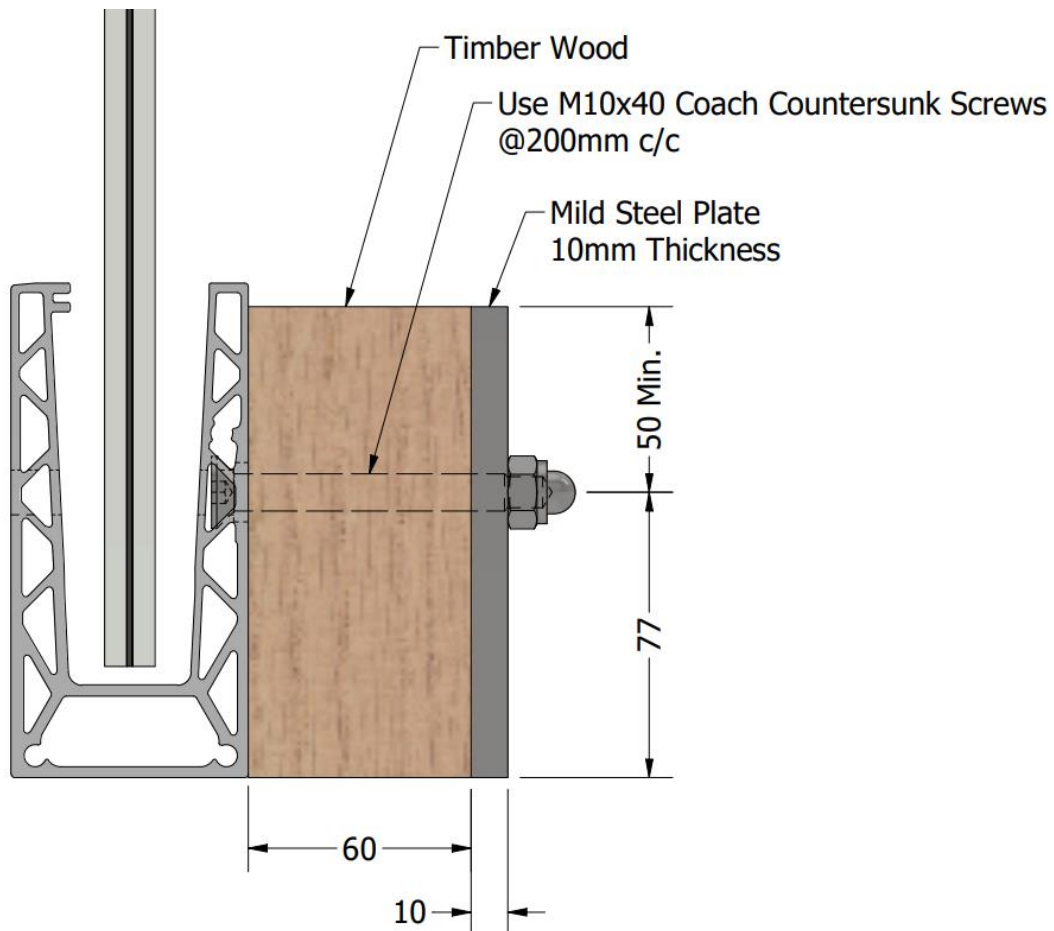

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 10
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

**Shoe Analysis:**  
**System Sketch:**

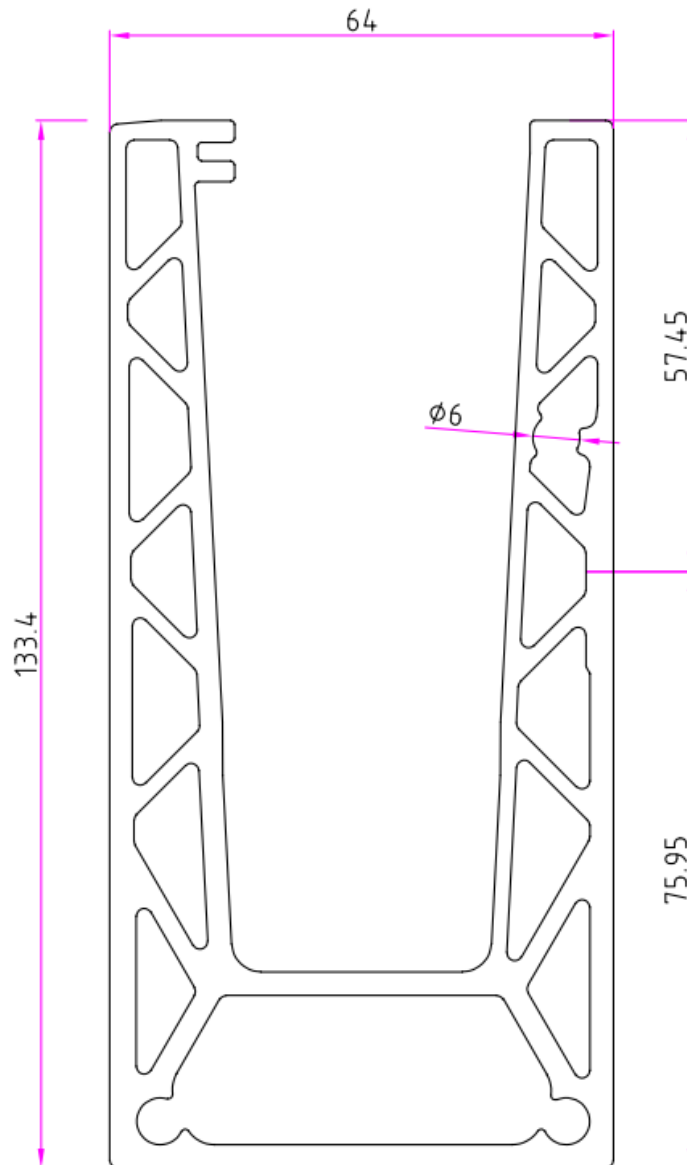

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 11
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC


### Bending Stress of Shoe:

- Analysis Software was used to determine maximum bending stress of the shoe due to maximum Moment.
- $Moment_{Wind} = 2.5\text{kN/m}^2 \times 1.2\text{m} \times 1.0\text{m} \times \frac{1.0\text{m}}{2} = 1.5\text{kN m(SLS)}$  **Worst Case**
- $Moment_{Balustrade} = 0.74\text{kN/m} \times 1.2\text{m} \times 1.0\text{m} = 0.89\text{kN m(SLS)}$

Result:

Max. Bending Stress =  $119.1\text{N/mm}^2 \times 1.5 = 178.65\text{N/mm}^2 < 195\text{N/mm}^2$

Okay in Bending

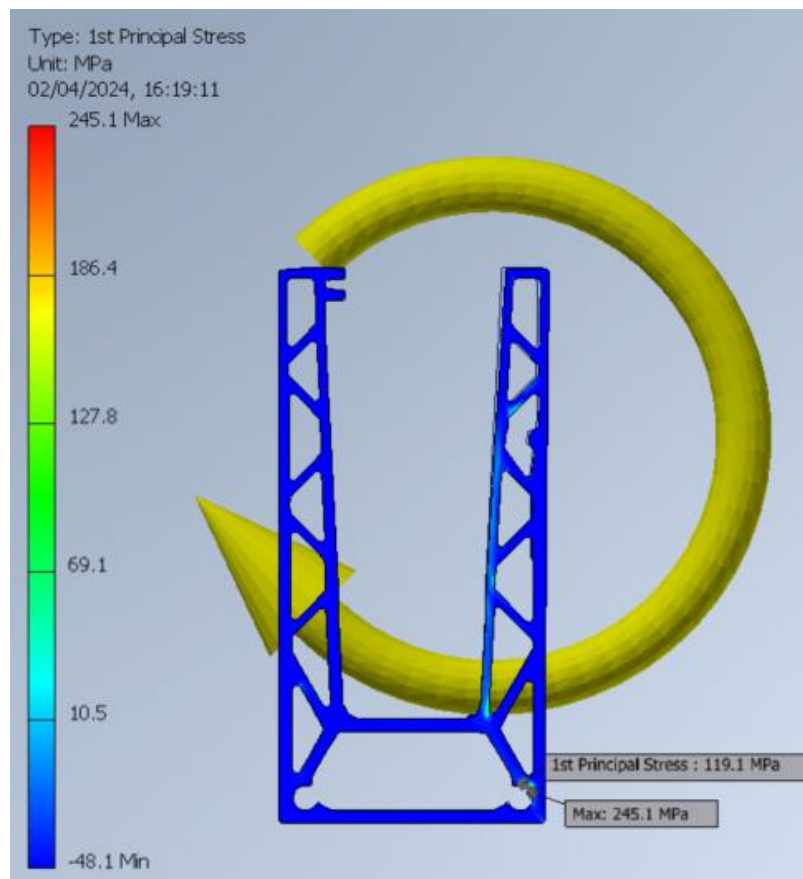


### NOTE:

In this case the 245.1 MPa is a localised stress. The most appropriate stress to be considered is 119.1 MPa.

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 12
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

**Deflection of Shoe:**

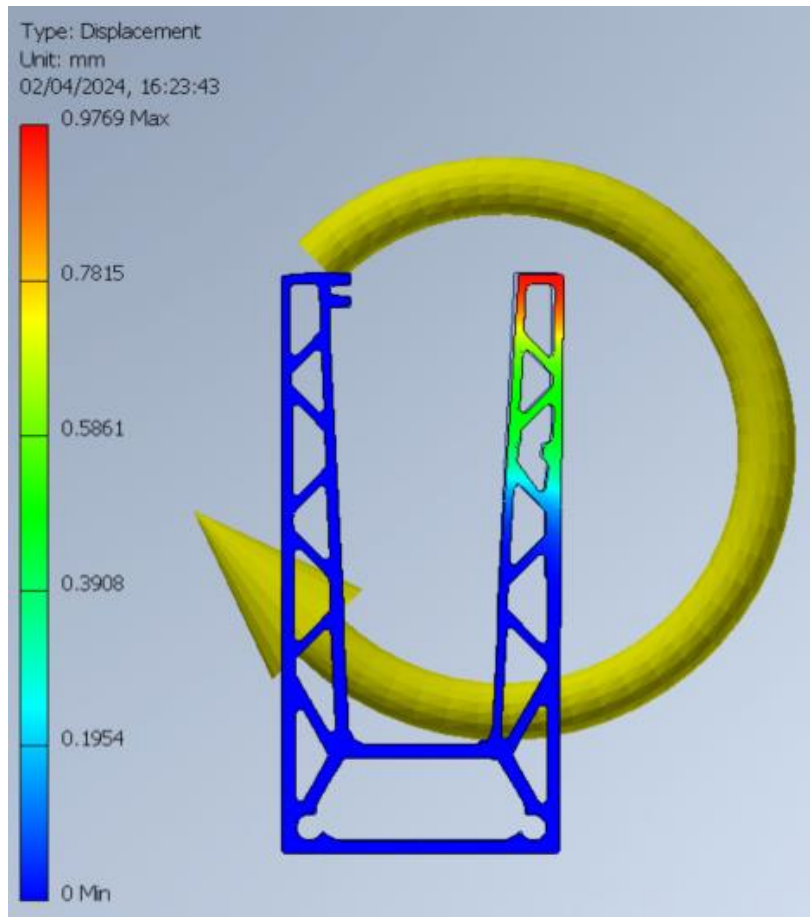

**NOTE:**

- Deflection 0.9769mm at the top of shoe
- Max. Deflection at the top of the glass =  $(0.9769 \times 1000)/86 = 11.36\text{mm}$



<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 13
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

## Appendix A – Timco Timber Screws Specification Sheet

TSA is Both the Designer and the Specifier of the Fixings.

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 14
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

## TIMco Coach Screws DIN571



### DECLARATION OF PERFORMANCE

DOP7 v2

We here by declare the following designated products  
**TIMco Coach Screws DIN571**  
**Diameter 6.0mm, 8.0mm, 10.0mm, 12.0mm**

Have been tested by the following independant testing organisation:

- Notified Body 1015

Strojirensky Zkusebni Ustav, s.p., Czech Republic

And that they have performed initial type testing under system 3, Annex V of the regulation (EU) no. 305/2011 (Construction Products Regulation), with the reference to the harmonised European standard (hEN) BS EN 14592:2008+A1:2012 (Timber structures - Dowel type fasteners - Requirements) for nails intended for the use in "load bearing timber structures" and produced the calculation/test reports and certificates as listed below;

Certificate Number: E-30-20414-13, E-30-20405-13, E-30-20406-13, E-30-20407-13.

Test Report Number: No. 30-9915/1 to No. 30-9915/4.

Factory Process Control (FPC) has been established by the factory and independently audited by TUV Rheinland UK in accordance with ISO9001:2008.

This declaration of conformity is valid until there is a significant change in the product and declared characteristics. ie. raw material or change in production process.

Signed by:



Name: *Simon Midwood*

Position: *Managing Director*

Date & Location: *29. 07. 2013*  
*TIMco House, CW5 6BJ*

This declaration is the responsibility of the importer

T.I Midwood & Co. Ltd. Green Lane, Wardle, Nantwich, Cheshire, CW5 6BJ





**TSA**  
TED SINGLETON & ASSOCIATES  
CONSULTING ENGINEERS

<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 15
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

## Declaration Of Performance

### TIMco Coach Screw DIN571 - Zinc

Size	Nominal diameter d (mm)	Inner thread diameter d1	Total Length L (mm)	Thread Length lg (mm)	Head diameter dh (mm)	Test Report No.	Certificate No.	Characteristic yield moment $M_{y,k}$ (Nm)		Characteristic withdrawal parameter $f_{ax,k}$ (N/mm <sup>2</sup> )		Characteristic head pull-through parameter $f_{head,k}$ (N/mm <sup>2</sup> )	Characteristic tensile capacity $f_{tens,k}$ (kN)	Characteristic torsional ratio
								Thread Section	Smooth Section	Loading across the fibre	Loading along the fiber			
6 x 25	6.0	4.2	25	15	10.0	No. 30-9915/1	E-30-20414-13	11 166	18 366	16,64	10,45	24,27	9.9	1,87*
6 x 30			30	18										
6 x 40			40	24										
6 x 50			50	30										
6 x 60			60	36										
6 x 65			65	39										
6 x 70			70	42										
6 x 75			75	45										
6 x 80			80	48										
6 x 100			100	60										
8 x 30	8.0	5.6	30	18	13.0	No. 30-9915/2	E-30-20405-13	22 852	41 589	13,91	8,52	22,20	16,21	1,50*
8 x 40			40	24										
8 x 50			50	30										
8 x 60			60	36										
8 x 65			65	39										
8 x 70			70	42										
8 x 75			75	45										
8 x 80			80	48										
8 x 90			90	54										
8 x 100			100	60										
8 x 150	150	90												
10 x 40	10.0	7.0	40	24	17.0	No. 30-9915/3	E-30-20406-13	42 887	89 040	12,47	10,04	22,13	26,45	2,18*
10 x 50			50	30										
10 x 60			60	36										
10 x 70			70	42										
10 x 75			75	45										
10 x 80			80	48										
10 x 100			100	60										
10 x 120			120	72										
10 x 130			130	78										
10 x 150			150	90										
10 x 200	200	120												
12 x 50	12.0	9.0	50	30	19.0	No. 30-9915/4	E-30-20407-13	82 789	147 141	12,24	9,81	21,12	40,37	2,11*
12 x 75			75	45										
12 x 80			80	48										
12 x 100			100	60										
12 x 150			150	90										



<b>Project:</b> Concorde Glass Ltd	<b>Contract:</b> 1983-1
<b>Subject:</b> Glassloc Side Mounted Fixing Data	<b>Sheet No.</b> 16
<b>Date:</b> 15/04/2024	<b>By:</b> A.N & R.F. & CC

## Appendix B – Fischer Reports

TSA is Both the Designer and the Specifier of the Fixings.



<p><b>Design Office</b>  <b>TSA Consulting Engineers</b>          Ted Singleton          4 BLACKWATER HOUSE          MALLOW BUSINESS PARK          GOULDS HILL          MALLOW          CO. CORK          P51 KC8C          Phone: 0868168300          ted@tsaconsulteng.ie          tsaconsulteng.ie</p>	<p><b>Client</b>  <b>Concorde Glass Ltd.,</b>           Linx House,          104 Waterloo Rd,          Mablethorpe,          LN12 1LE,          UK.</p>	<p><b>MASONRY FIXINGS</b>           Unit 83, Cherry Orchard Industrial Estate          Dublin 10          Phone: +353 1 642 6700          Fax: +353 1 626 2197          technical@masonryfixings.ie          www.masonryfixings.ie</p>
---	---	--

**Comment**

1983-1\_Side Mount\_Connection to Concrete\_0

**Design Specifications**

**Anchor**



Anchor system	fischer Concrete screw ULTRACUT FBS II
Anchor	Concrete screw with countersunk head FBS II 10x65 10/- SK, zinc plated steel
Calculated anchorage depth	43 mm
Design Data	Determined by manufacturer



**Geometry / Loads / Scale units**

mm, kN, kNm

Value of design actions (including partial safety factor for the load)

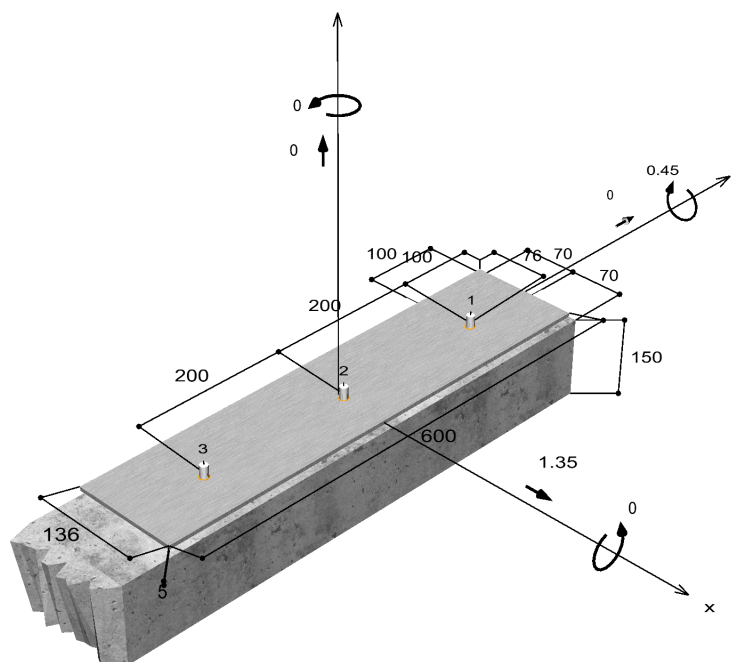

Not drawn to scale

The input values and the design results should be checked against local valid standards and approvals. Please respect the disclaimer of warranty in the license agreement of the Software.

### Input data

Design method	TR055/Design method ENSO Mechanical
Base material	C30/37, EN 206
Concrete condition	Cracked, dry hole
Reinforcement	No or standard reinforcement. No edge reinforcement. With reinforcement against splitting
Drilling method	Hammer drilling
Installation type	Push-through installation
Annular gap	Annular gap filled
Type of loading	Permanent-Transient/Static
Base plate location	Base plate flush installed on base material
Base plate geometry	136 mm x 600 mm x 5 mm
Profile type	None


### Design actions \*)

#	N <sub>Sd</sub> kN	V <sub>Sd,x</sub> kN	V <sub>Sd,y</sub> kN	M <sub>Sd,x</sub> kNm	M <sub>Sd,y</sub> kNm	M <sub>T,Sd</sub> kNm	Type of loading
1	0.00	1.35	0.00	0.00	0.45	0.00	Permanent-Transient/Static

\*) The required partial safety factors for actions are included

### Resulting anchor forces

Anchor no.	Tensile action kN	Shear Action kN	Shear Action x kN	Shear Action y kN
1	2.70	0.45	0.45	0.00
2	2.70	0.45	0.45	0.00
3	2.70	0.45	0.45	0.00



max. concrete compressive strain :	0.06 ‰
max. concrete compressive stress :	2.0 N/mm <sup>2</sup>
Resulting tensile actions :	8.11 kN , X/Y position ( 8 / 0 )
Resulting compression actions :	8.11 kN , X/Y position ( 64 / 0 )


### Resistance to tension loads

Proof	Action kN	Capacity kN	Utilisation $\beta_N$ %
Steel failure *	2.70	39.29	6.9
Pullout failure *	2.70	7.32	<b>36.9</b>
Concrete cone failure	2.70	8.23	32.8

\* Most unfavourable anchor

### Steel failure

$$N_{Sd} \leq \frac{N_{Rk,s}}{\gamma_{Ms}} \quad (N_{Rd,s})$$




$N_{Rk,s}$ kN	$\gamma_{Ms}$	$N_{Rd,s}$ kN	$N_{Sd}$ kN	$\beta_{N,s}$ %
55.00	1.40	39.29	2.70	6.9

Anchor no.	$\beta_{N,s}$ %	Group N°	Decisive Beta
1	6.9	1	$\beta_{N,s;1}$
2	6.9	2	$\beta_{N,s;2}$
3	6.9	3	$\beta_{N,s;3}$

### Pullout failure

$$N_{Sd} \leq \frac{N_{Rk,p}}{\gamma_{Mp}} \quad (N_{Rd,p})$$




$N_{Rk,p}$ kN	$\Psi_c$	$\gamma_{Mp}$	$N_{Rd,p}$ kN	$N_{Sd}$ kN	$\beta_{N,p}$ %
10.98	1.220	1.50	7.32	2.70	36.9

The given Psi,c-factor may has been determined by interpolation.

Anchor no.	$\beta_{N,p}$ %	Group N°	Decisive Beta
1, 2, 3	36.9	1	$\beta_{N,p;1}$

### Concrete cone failure

$$N_{Sd} \leq \frac{N_{Rk,c}}{\gamma_{Mc}} \quad (N_{Rd,c})$$



$$N_{Rk,c} = N_{Rk,c}^0 \cdot \frac{A_{c,N}}{A_{c,N}^0} \cdot \Psi_{s,N} \cdot \Psi_{re,N} \cdot \Psi_{ec,N} \quad \text{Eq. (5.2)}$$

$$N_{Rk,c} = 12.35kN \cdot \frac{16,641mm^2}{16,641mm^2} \cdot 1.000 \cdot 1.000 \cdot 1.000 = 12.35kN$$

$$N_{Rk,c}^0 = k_1 \cdot \sqrt{f_{ck,cube}} \cdot h_{ef}^{1.5} = 7.2 \cdot \sqrt{37.0N/mm^2} \cdot (43mm)^{1.5} = 12.35kN \quad \text{Eq. (5.2a)}$$

$$\Psi_{s,N} = \min\left(1; 0.7 + 0.3 \cdot \frac{c}{c_{cr,N}}\right) = \min\left(1; 0.7 + 0.3 \cdot \frac{70mm}{65mm}\right) = 1.000 \leq 1 \quad \text{Eq. (5.2c)}$$

$$\Psi_{re,N} = 1.000 \quad \text{Eq. (5.2d)}$$

$$\Psi_{ec,N} = \frac{1}{1 + \frac{2e_n}{s_{cr,N}}} \Rightarrow \Psi_{ec,Nx} \cdot \Psi_{ec,Ny} = 1.000 \cdot 1.000 = 1.000 \leq 1 \quad \text{Eq. (5.2e)}$$

$$\Psi_{ec,Nx} = \frac{1}{1 + \frac{2 \cdot 0mm}{129mm}} = 1.000 \leq 1 \quad \Psi_{ec,Ny} = \frac{1}{1 + \frac{2 \cdot 0mm}{129mm}} = 1.000 \leq 1$$

<b>N<sub>Rk,c</sub></b> kN	<b>Y<sub>Mc</sub></b>	<b>N<sub>Rd,c</sub></b> kN	<b>N<sub>Sd</sub></b> kN	<b>β<sub>N,c</sub></b> %
12.35	1.50	8.23	2.70	32.8

<b>Anchor no.</b>	<b>β<sub>N,c</sub></b> %	<b>Group N°</b>	<b>Decisive Beta</b>
1	32.8	1	β <sub>N,c;1</sub>
2	32.8	2	β <sub>N,c;2</sub>
3	32.8	3	β <sub>N,c;3</sub>


## Resistance to shear loads

<b>Proof</b>	<b>Action</b> kN	<b>Capacity</b> kN	<b>Utilisation β<sub>v</sub></b> %
Steel failure without lever arm *	0.45	19.60	2.3
Concrete pry-out failure	0.45	8.23	5.5
Concrete edge failure	1.35	6.10	<b>22.1</b>

\* Most unfavourable anchor

### Steel failure without lever arm

$$V_{Sd} \leq \frac{V_{Rk,s}}{\gamma_{Ms}} \quad (V_{Rd,s})$$




<b>V<sub>Rk,s</sub></b> kN	<b>Y<sub>Ms</sub></b>	<b>V<sub>Rd,s</sub></b> kN	<b>V<sub>Sd</sub></b> kN	<b>β<sub>Vs</sub></b> %
29.40	1.50	19.60	0.45	2.3

<b>Anchor no.</b>	<b>β<sub>Vs</sub></b> %	<b>Group N°</b>	<b>Decisive Beta</b>
1	2.3	1	β <sub>Vs;1</sub>
2	2.3	2	β <sub>Vs;2</sub>
3	2.3	3	β <sub>Vs;3</sub>

### Concrete pry-out failure

$$V_{Sd} \leq \frac{V_{Rk,cp}}{\gamma_{Mcp}} \quad (V_{Rd,cp})$$



$$V_{Rk,cp} = k \cdot N_{Rk,c} = 1 \cdot 12.35kN = 12.35kN \quad \text{Eq. (5.6)}$$

$$N_{Rk,c} = N_{Rk,c}^0 \cdot \frac{A_{c,N}}{A_{c,N}^0} \cdot \Psi_{s,N} \cdot \Psi_{re,N} \cdot \Psi_{ec,N} \quad \text{Eq. (5.2)}$$

$$N_{Rk,c} = 12.35kN \cdot \frac{16,641mm^2}{16,641mm^2} \cdot 1.000 \cdot 1.000 \cdot 1.000 = 12.35kN$$

$$N_{Rk,c}^0 = k_1 \cdot \sqrt{f_{ck,cube}} \cdot h_{ef}^{1.5} = 7.2 \cdot \sqrt{37.0N/mm^2} \cdot (43mm)^{1.5} = 12.35kN \quad \text{Eq. (5.2a)}$$

$$\Psi_{s,N} = \min\left(1; 0.7 + 0.3 \cdot \frac{c}{c_{cr,N}}\right) = \min\left(1; 0.7 + 0.3 \cdot \frac{70mm}{65mm}\right) = 1.000 \leq 1 \quad \text{Eq. (5.2c)}$$

$$\Psi_{re,N} = 1.000 \quad \text{Eq. (5.2d)}$$


$$\Psi_{ec,N} = \frac{1}{1 + \frac{2e_a}{s_{cr,N}}} \Rightarrow \Psi_{ec,Nx} \cdot \Psi_{ec,Ny} = 1.000 \cdot 1.000 = 1.000 \leq 1 \quad \text{Eq. (5.2e)}$$

$V_{Rk,cp}$ kN	$\gamma_{Mc}$	$V_{Rd,cp}$ kN	$V_{Sd}$ kN	$\beta_{V,cp}$ %
12.35	1.50	8.23	0.45	5.5

Anchor no.	$\beta_{V,cp}$ %	Group N°	Decisive Beta
1	5.5	1	$\beta_{V,cp;1}$
2	5.5	2	$\beta_{V,cp;2}$
3	5.5	3	$\beta_{V,cp;3}$

### Concrete edge failure

$$V_{Sd} \leq \frac{V_{Rk,c}}{\gamma_{Mc}} \quad (V_{Rd,c})$$



$$V_{Rk,c} = V_{Rk,c}^0 \cdot \frac{A_{c,V}}{A_{c,V}^0} \cdot \Psi_{s,V} \cdot \Psi_{h,V} \cdot \Psi_{\alpha,V} \cdot \Psi_{ec,V} \cdot \Psi_{re,V} \quad \text{Eq. (5.7)}$$

$$V_{Rk,c} = 15.55kN \cdot \frac{21,000mm^2}{45,000mm^2} \cdot 0.840 \cdot 1.000 \cdot 1.500 \cdot 1.000 \cdot 1.000 = 9.14kN$$

$$V_{Rk,c}^0 = k_1 \cdot d_{nom}^\alpha \cdot h_{ef}^\beta \cdot \sqrt{f_{ck,cube}} \cdot c_1^{1.5} \quad \text{Eq. (5.7a)}$$

$$V_{Rk,c}^0 = 1.7 \cdot (10mm)^{0.074} \cdot (43mm)^{0.063} \cdot \sqrt{37.0N/mm^2} \cdot (100mm)^{1.5} = 15.55kN$$

$$\alpha = 0.1 \cdot \sqrt{\frac{l_f}{c_1}} = 0.1 \cdot \sqrt{\frac{55mm}{100mm}} = 0.074 \quad \beta = 0.1 \cdot \left(\frac{d_{nom}}{c_1}\right)^{0.2} = 0.1 \cdot \left(\frac{10mm}{100mm}\right)^{0.2} = 0.063 \quad \text{Eq. (5.7b/c)}$$

$$\Psi_{s,V} = 0.7 + 0.3 \cdot \frac{c_2}{1.5c_1} = 0.7 + 0.3 \cdot \frac{70mm}{1.5 \cdot 100mm} = 0.840 \leq 1 \quad \text{Eq. (5.7e)}$$

$$\Psi_{h,V} = \max\left(1; \sqrt{\frac{1.5c_1}{h}}\right) = \max\left(1; \sqrt{\frac{1.5 \cdot 100mm}{150mm}}\right) = 1.000 \geq 1 \quad \text{Eq. (5.7f)}$$

$$\Psi_{\alpha,V} = \sqrt{\frac{1}{(\cos \alpha_V)^2 + \left(\frac{\sin \alpha_V}{\Psi_{90,V}}\right)^2}} = \sqrt{\frac{1}{(\cos 90.0)^2 + \left(\frac{\sin 90.0}{1.5}\right)^2}} = 1.500 \geq 1 \quad \text{Eq. (10.2-5f)}$$

$$\Psi_{ec,V} = \frac{1}{1 + \frac{2 \cdot e_v}{3 \cdot c'_1}} = \frac{1}{1 + \frac{2 \cdot 0mm}{3 \cdot 100mm}} = 1.000 \leq 1 \quad \text{Eq. (5.7h)}$$

$$\Psi_{re,V} = 1.000$$

$$c'_1 = \max\left(\frac{c_{2,max}}{1.5}; \frac{h}{1.5}\right) = \max\left(\frac{70mm}{1.5}; \frac{150mm}{1.5}\right) = 100mm$$

V <sub>Rk,c</sub> kN	Y <sub>Mc</sub>	V <sub>Rd,c</sub> kN	V <sub>Sd</sub> kN	β <sub>V,c</sub> %
9.14	1.50	6.10	1.35	22.1

Anchor no.	β <sub>V,c</sub> %	Group N°	Decisive Beta
1	7.4	1	β <sub>V,c;1</sub>
2	14.8	2	β <sub>V,c;2</sub>
3	22.1	3	β <sub>V,c;3</sub>

## Utilization of tension and shear loads

Tension loads	Utilisation β <sub>N</sub> %	Shear Loads	Utilisation β <sub>V</sub> %
Steel failure *	6.9	Steel failure without lever arm *	2.3
Pullout failure *	<b>36.9</b>	Concrete pry-out failure	5.5
Concrete cone failure	32.8	Concrete edge failure	<b>22.1</b>

\* Most unfavourable anchor

## Resistance to combined tensile and shear loads

Utilisation steel		
$\beta_{N,s} = \beta_{N,s;1} = 0.07 \leq 1$		Eq. (5.8a)
$\beta_{V,s} = \beta_{V,s;1} = 0.02 \leq 1$		Eq. (5.8b)
$\beta_N^2 + \beta_V^2 = \beta_{N,s;1}^2 + \beta_{V,s;1}^2 = 0.01 \leq 1$		Eq. (5.9)
<b>Utilisation concrete</b>		<b>Proof successful</b>
$\beta_{N,p} = \beta_{N,p;1} = 0.37 \leq 1$		Eq. (5.8a)
$\beta_{V,c} = \beta_{V,c;3} = 0.22 \leq 1$		Eq. (5.8b)
$\frac{\beta_N + \beta_V}{1.2} = \frac{\beta_{N,p;1} + \beta_{V,c;3}}{1.2} = 0.35 \leq 1$		Eq. (5.8c)

## Information concerning the anchor plate

### Base plate details

Plate thickness specified by user without proof

t = 5 mm

Profile type

None

The input values and the design results should be checked against local valid standards and approvals. Please respect the disclaimer of warranty in the license agreement of the Software.



## **Technical remarks**

All data and information in the software is based on fischer products and common engineering knowledge. Please check all the proof results against local valid standards and approvals.

As fischer is not the design office, the attached is no guarantee for incorrect input or assumptions. Any recommendations have to be approved by the building-authority or project engineer. Results are valid only for anchor system calculated in the attached. If any part of the system is changed, it will invalidate this report and new calculations would be required. The calculation was done under the assumption that a sufficient splitting reinforcement is available. In this case the splitting failure can be omitted.

The transmission of the anchor loads to the supports of the concrete member shall be shown for the ultimate limit state and the serviceability limit state; for this purpose, the normal verifications shall be carried out under due consideration of the actions introduced by the anchors. For these verifications the additional provisions given in the current design method shall be taken into account.

As a pre-condition the anchor plate is assumed to be flat when subjected to the actions. Therefore, the plate (if present) must be sufficiently stiff. The C-Fix anchor plate design is based on a proof of stresses and does not allow a statement about the stiffness of the plate. The proof of the necessary stiffness is not carried out by C-Fix.

During the design process, the following hints and warnings were issued:

- Measures must be taken to fill the annular gap on site.

## Installation data

### Anchor

**Anchor system**      **fischer Concrete screw ULTRACUT FBS II**  
 Anchor                  Concrete screw with countersunk head FBS II 10x65 10/- SK, zinc plated steel

Art.-No. 536884




**Accessories**                  Blow-out pump ABG big Quattric II 10/100/165

Art.-No. 567792  
 Art.-No. 549923

### Installation details

Thread diameter                  -  
 Drill hole diameter               $d_0 = 10 \text{ mm}$   
 Drill hole depth                   $h_2 = 75 \text{ mm}$   
 Calculated anchorage depth       $h_{ef} = 43 \text{ mm}$   
 Installation depth                   $h_{nom} = 55 \text{ mm}$   
 Counter-sink size                  23 mm x 5 mm  
 Drilling method                    Hammer drilling  
 Borehole cleaning                Clear the borehole with a hand blower.  
 Installation type                  Push-through installation  
 Annular gap                        Annular gap filled  
 Maximum torque                  -  
 Socket size                         T50  
 Base plate thickness               $t = 5 \text{ mm}$   
 Total fixing thickness            $t_{fix} = 5 \text{ mm}$   
 $T_{fix,max}$                            $t_{fix,max} = 10 \text{ mm}$

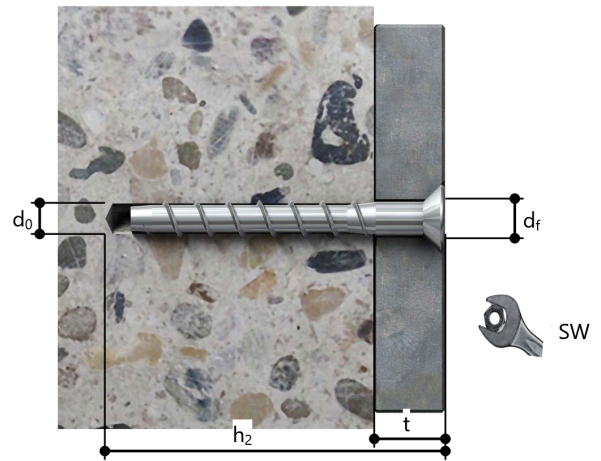

### Base plate details

Base plate material                Not available  
 Base plate thickness               $t = 5 \text{ mm}$   
 Clearance hole in base plate       $d_f = 14 \text{ mm}$

### Attachment

Profile type                         None

### Anchor coordinates

Anchor no.	x mm	y mm
1	8	200
2	8	0
3	8	-200

